

*Results of Tests on Brick conducted in accordance with ASTM C67-12 Standard Method for Sampling and*

*Testing Brick and Structural Clay Tile*

04/08/2013

Name:	Whitacre-Greer Fireproofing Company 1400 South Mahoning Avenue Alliance, OH 44601	Plant:	Whitacre-Greer Fireproofing Company
Phone:	(330) 206-2009	Report Number:	WGFC-0059
Fax:		Sampled Date:	02/28/2013
		Lot:	
		Product Code:	

Sample Description: **4x8x2-1/4 40 Series Paver sealer removed**


	1	2	3	4	5	Average	Test Date
<b>Absorption</b>							
24 Hour Submersion in Cold Water (%)	3.76	3.70	3.70	4.13	4.02	3.86	03/20/2013
5 Hour Submersion in Boiling Water (%)	5.37	5.22	5.11	5.56	5.40	5.33	
Saturation Coefficient (Ratio of 24H to 5H)	0.70	0.71	0.72	0.74	0.74	0.72	
<b>Compressive Strength</b>							
psi	12,849	13,146	14,194	12,411	13,443	13,209	03/21/2013
MPa	88.6	90.6	97.9	85.6	92.7	91.1	
<b>Abrasion Resistance</b>							
	0.03	0.03	0.03	0.03	0.03	0.03	03/14/2013

*The brick represented by the test results shown here comply with the standards listed below:*


ASTM C 902 - 12 Standard Specification for Pedestrian and Light Traffic Paving Brick

Class: SX, MX, NX, except for efflorescence

Type: I, II, III

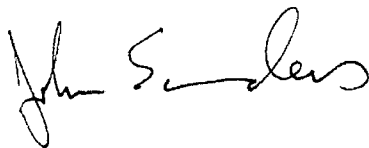

John Sanders, Ph.D., PE, Director

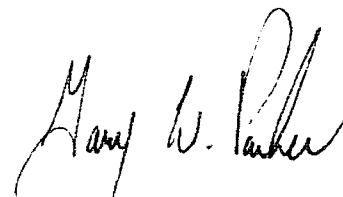

Gary W. Parker, Laboratory Supervisor